



U:\1201\Permitting\CAAG\CAAG\1201-D102.dwg, FIGURE 2, 9/24/2009 11:27:07 AM, C.rvt

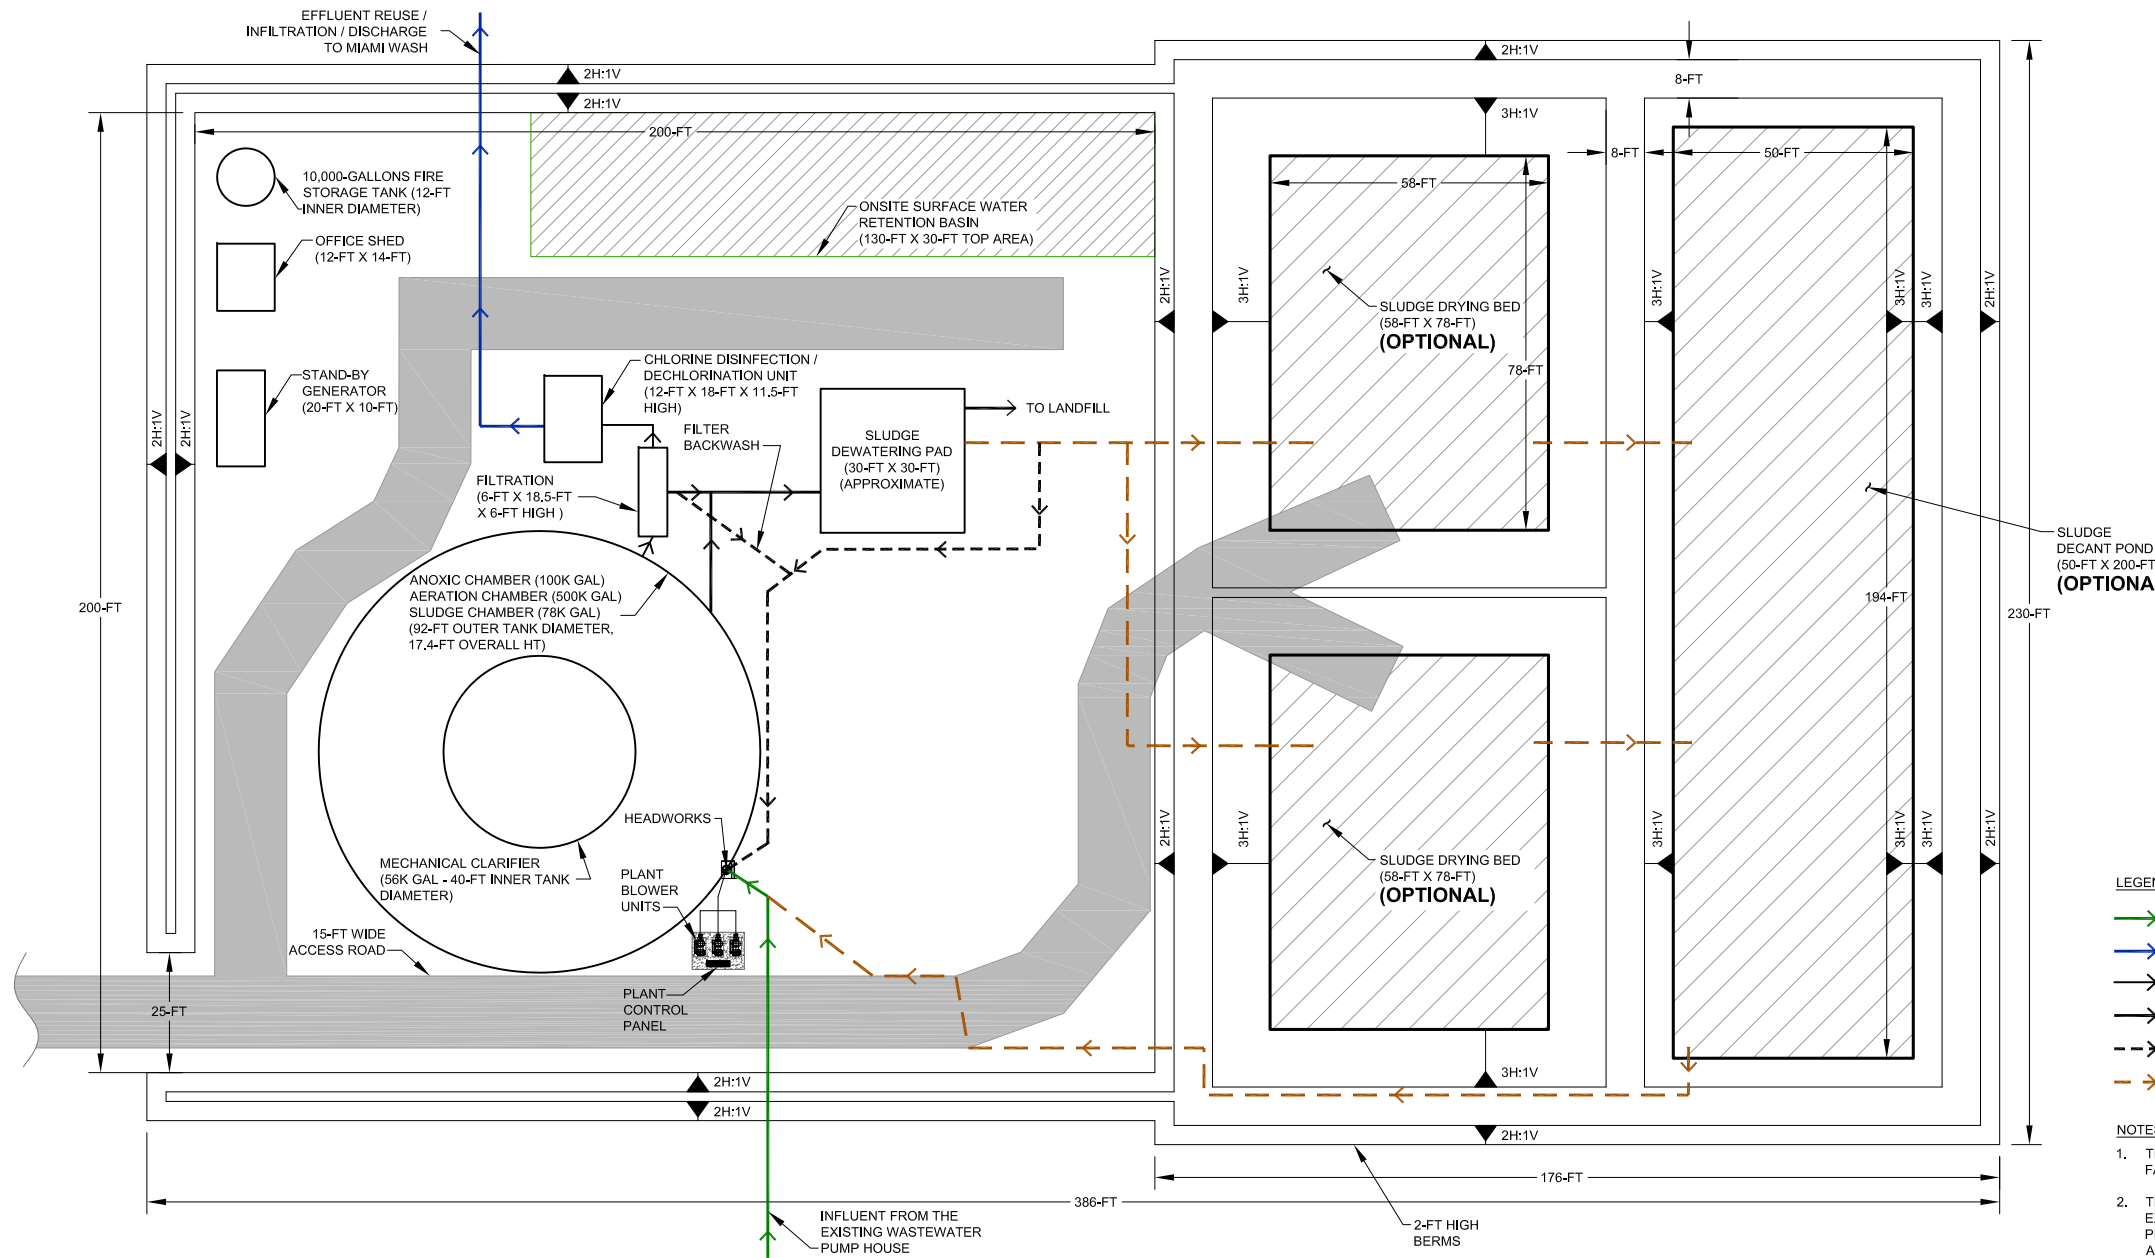

- LEGEND:**
- INFLUENT WASTE WATER
 - EFFLUENT WATER
 - CLARIFIER EFFLUENT
 - WASTE ACTIVATED SLUDGE
 - RETURN ACTIVATED SLUDGE
 - WASTE ACTIVATED SLUDGE (OPTIONAL)

- NOTES:**
1. THE SITE LAYOUT FOR THE WASTEWATER RECLAMATION FACILITY PRESENTED HEREIN IS CONCEPTUAL.
 2. THE TREATMENT TECHNOLOGY ASSUMED IS AN EXTENDED AERATION (MODIFIED ACTIVATED SLUDGE PROCESS) WITH THE DESIGN CAPACITY OF 640,000 GPD AS PROPOSED BY ASHBROOK SIMON-HARTLEY.
 3. SLUDGE DRYING BED ASSUMES 2-FW FREEBOARD.
 4. THE TOTAL SITE AREA INCLUDING DRYING BEDS IS APPROXIMATELY 2 ACRES.



DRAFT - NOT FOR CONSTRUCTION

NO.	DATE	ISSUED FOR	ISSUED BY	APP'D BY
1	09/24/09	CLIENT REVIEW		